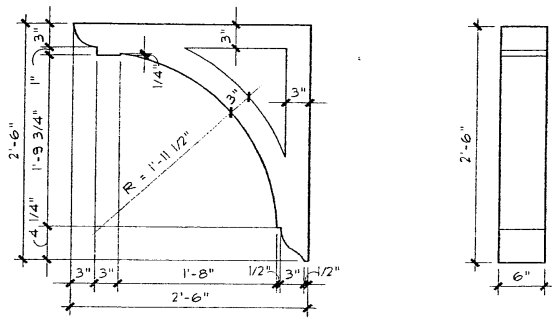

* Installation only *

7
A6.1

Exterior Bracket Detail

SCALE 1" = 1'-0"

BUILDING
WALL SECTIO
AND DETAIL

DESIGN	DRAWN
LGD	BKS

SHEET TITLE

DATE	NO	DESCRIPTION
10-31-07		RELEASE FOR PERMIT AND CONSTRUCTION

RELEASE

10-31-07
DATE

A07145B
PROJ NUMBER

145B-A6.1.dwg
CAD FILE NAME

FILE NUMBER

A6.1

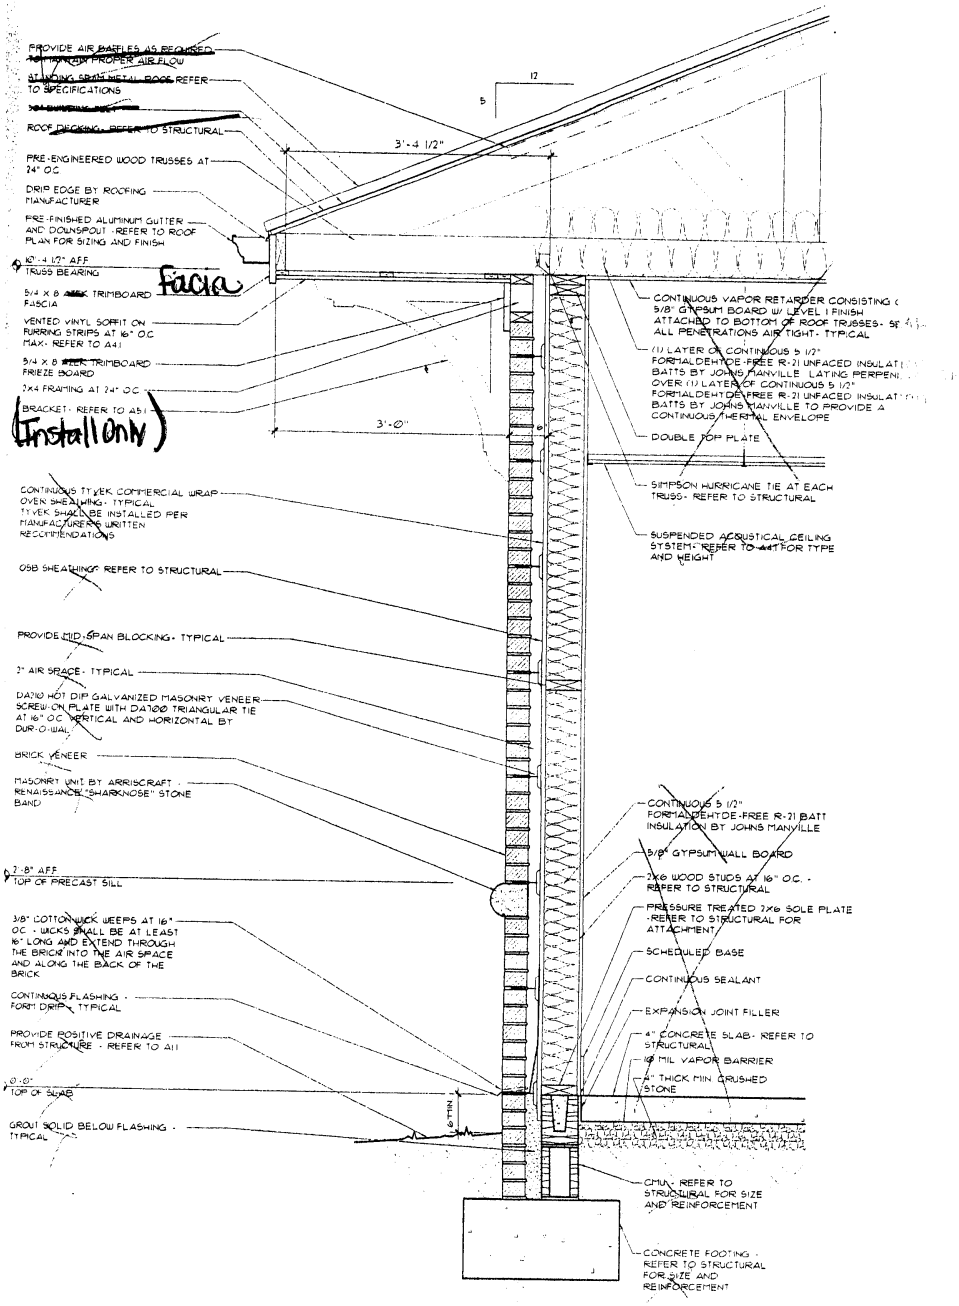
PROVIDE AIR BAFFLES AS REQUIRED TO MAINTAIN PROPER AIR FLOW
STANDING SEAM METAL ROOF REFER TO SPECIFICATIONS
ROOF DECKING - REFER TO STRUCTURAL
PRE-ENGINEERED WOOD TRUSSES AT 24" OC
DRIP EDGE BY ROOFING MANUFACTURER
PRE-FINISHED ALUMINUM GUTTER AND DOWNSPOUT - REFER TO ROOF PLAN FOR SIZING AND FINISH
10'-4 1/2" AFF
TRUSS BEARING
Facia
5/4 X 8 TRIMBOARD FASCIA
VENTED VINYL SOFFIT ON FURRING STRIPS AT 16" OC MAX - REFER TO A41
5/4 X 8 TRIMBOARD FRIEZE BOARD
2X4 FRAMING AT 24" OC
BRACKET - REFER TO A51
(Install Only)
3'-4 1/2"
12
5
3'-0"
CONTINUOUS VAPOR RETARDER CONSISTING OF 5/8" GYPSUM BOARD W/ LEVEL 1 FINISH ATTACHED TO BOTTOM OF ROOF TRUSSES - SEAL ALL PENETRATIONS AIR TIGHT - TYPICAL
(1) LAYER OF CONTINUOUS 5 1/2" FORMALDEHYDE-FREE R-21 UNFACED INSULATION BATTS BY JOHNS MANVILLE LAYING PERPENDICULAR OVER (1) LAYER OF CONTINUOUS 5 1/2" FORMALDEHYDE-FREE R-21 UNFACED INSULATION BATTS BY JOHNS MANVILLE TO PROVIDE A CONTINUOUS THERMAL ENVELOPE
DOUBLE TOP PLATE
SIMPSON HURRICANE TIE AT EACH TRUSS - REFER TO STRUCTURAL
SUSPENDED ACOUSTICAL CEILING SYSTEM - REFER TO A41 FOR TYPE AND HEIGHT
CONTINUOUS TYVEK COMMERCIAL WRAP OVER SHEATHING - TYPICAL TYVEK SHALL BE INSTALLED PER MANUFACTURER'S WRITTEN RECOMMENDATIONS
OSB SHEATHING - REFER TO STRUCTURAL
PROVIDE MID-SPAN BLOCKING - TYPICAL
2" AIR SPACE - TYPICAL
DA210 HOT DIP GALVANIZED MASONRY VENEER SCREW-ON PLATE WITH DA1200 TRIANGULAR TIE AT 16" OC VERTICAL AND HORIZONTAL BY DUR-O-WAL
BRICK VENEER
MASONRY UNIT BY ARRISCRAFT - RENAISSANCE "SMARKNOSE" STONE BAND
CONTINUOUS 5 1/2" FORMALDEHYDE-FREE R-21 BATT INSULATION BY JOHNS MANVILLE
5/8" GYPSUM WALL BOARD
2X6 WOOD STUDS AT 16" O.C. - REFER TO STRUCTURAL
PRESSURE TREATED 2X6 SOLE PLATE - REFER TO STRUCTURAL FOR ATTACHMENT
SCHEDULED BASE
CONTINUOUS SEALANT
EXPANSION JOINT FILLER
4" CONCRETE SLAB - REFER TO STRUCTURAL
6 MIL VAPOR BARRIER
4" THICK MIN CRUSHED STONE
2'-8" AFF
TOP OF PRECAST SILL
3/8" COTTON WICK WEEPS AT 16" OC - WICKS SHALL BE AT LEAST 16" LONG AND EXTEND THROUGH THE BRICK INTO THE AIR SPACE AND ALONG THE BACK OF THE BRICK
CONTINUOUS FLASHING - FORM DRIP - TYPICAL
PROVIDE POSITIVE DRAINAGE FROM STRUCTURE - REFER TO A11
0'-0"
TOP OF SLAB
6" TYP
GROUT SOLID BELOW FLASHING - TYPICAL
CMU - REFER TO STRUCTURAL FOR SIZE AND REINFORCEMENT
CONCRETE FOOTING - REFER TO STRUCTURAL FOR SIZE AND REINFORCEMENT

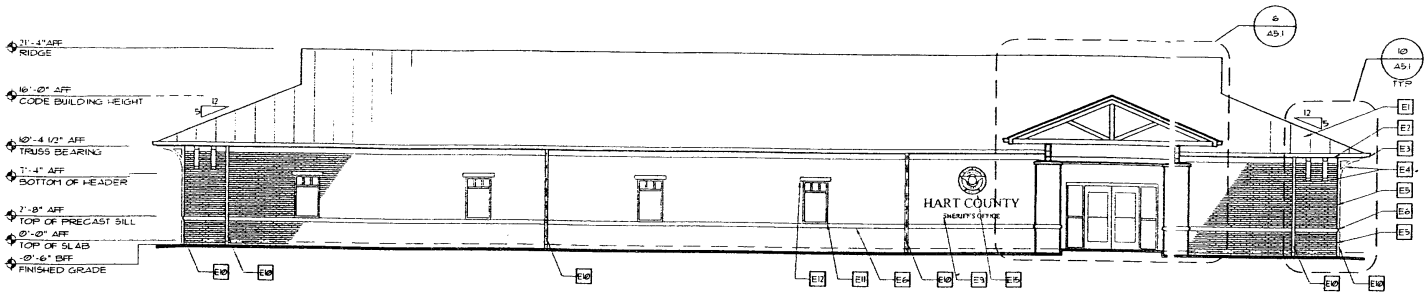

1 / A5.1 North Elevation

SCALE 1/8" = 1'-0"

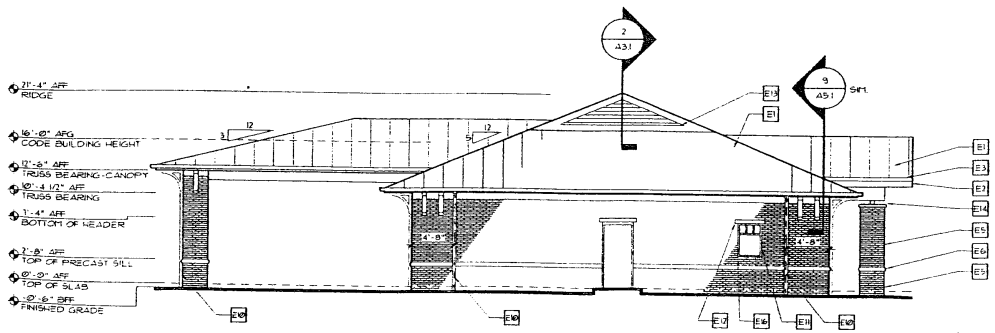

2 / A5.1 East Elevation

SCALE 1/8" = 1'-0"

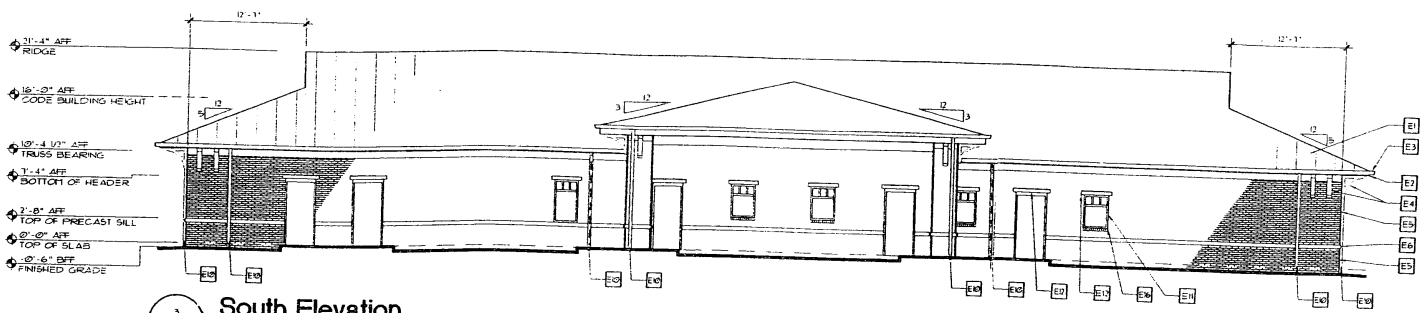

3 A5.1 **South Elevation**

SCALE 1/8" = 1'-0"

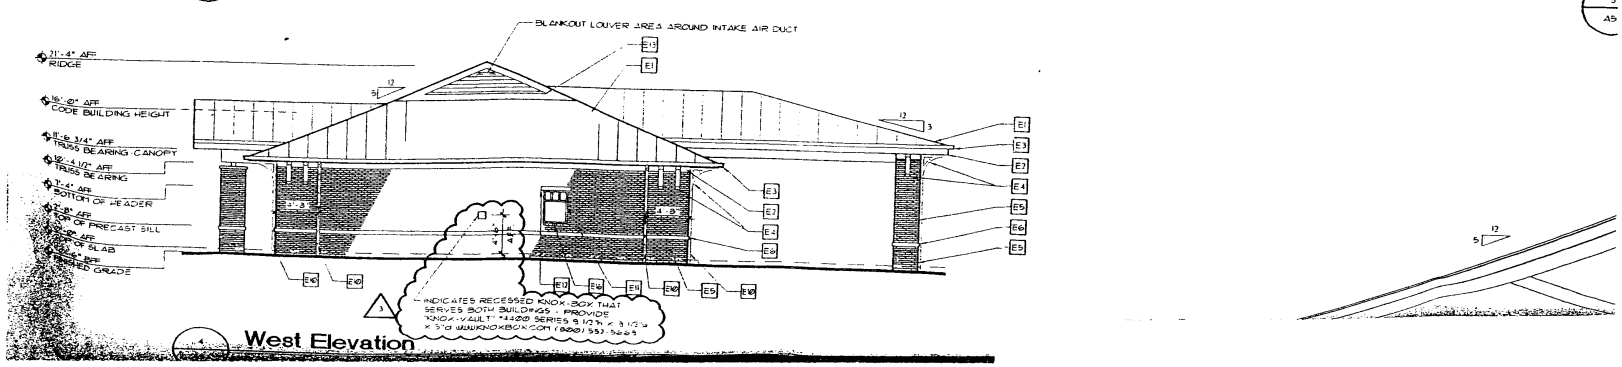

4 **West Elevation**

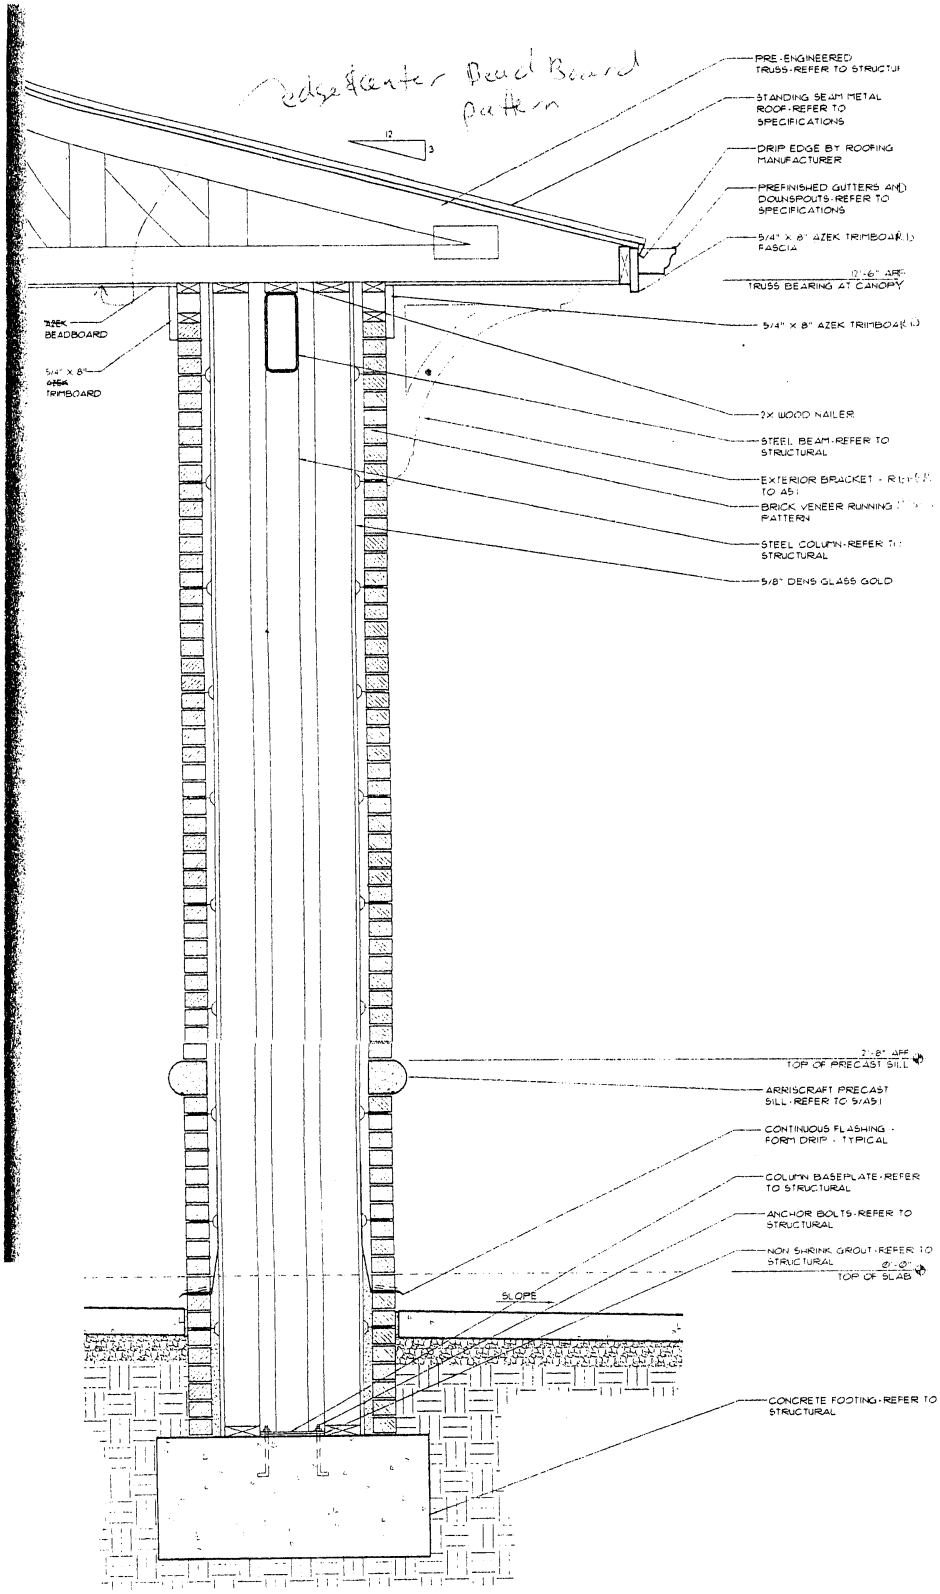

2
A6.2

Vehicle Canopy Section

SCALE 1" = 1'-0"

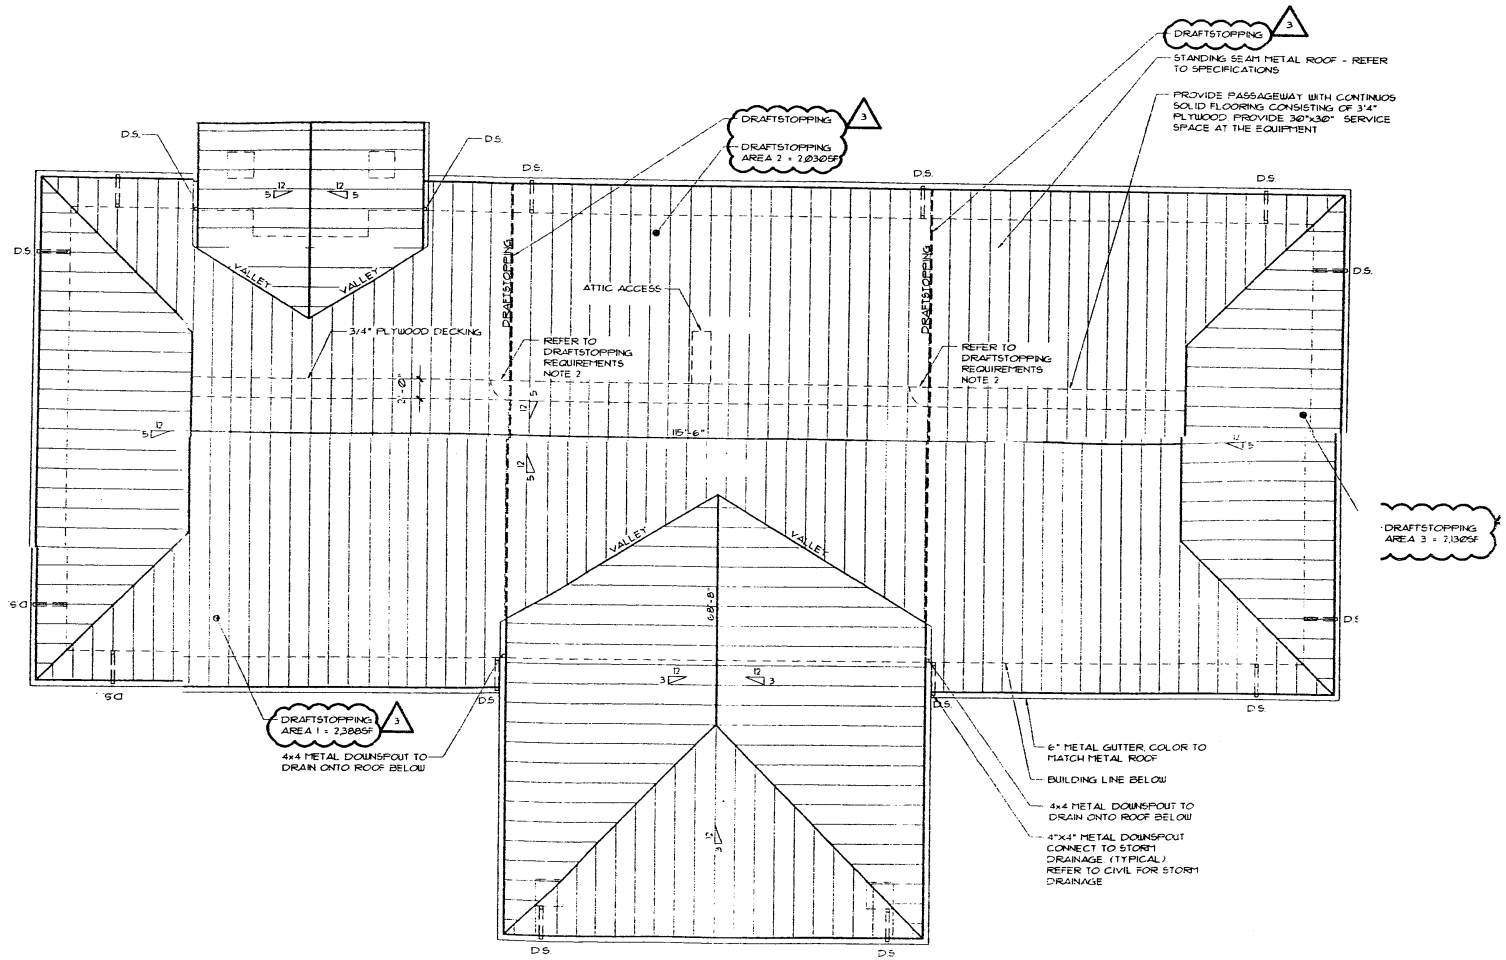

1 A31 **Roof Plan**

SCALE 1/8" = 1'-0"

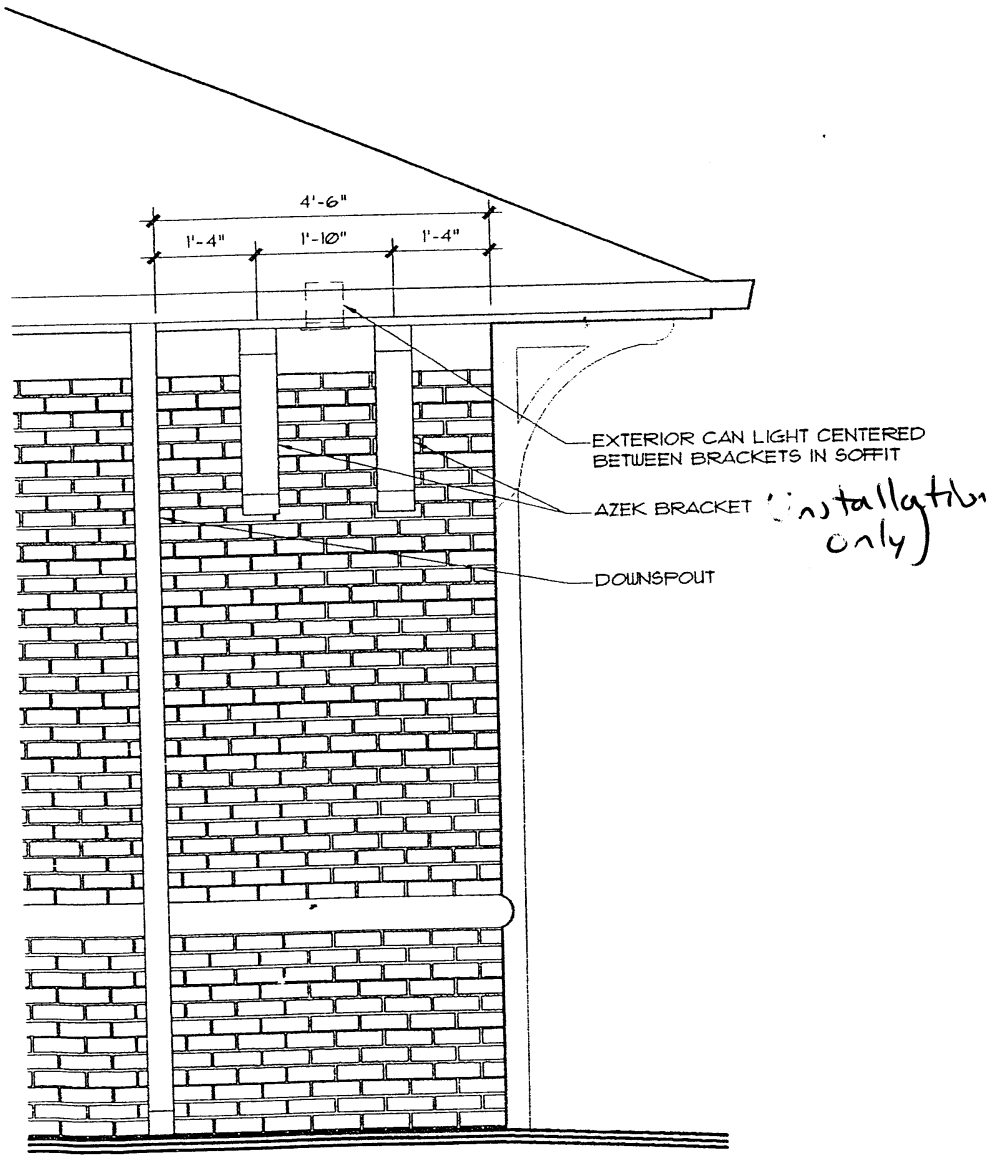

Enlarged Corner Detail

10
A5.1

SCALE 1/2" = 1'-0"

ELEVATIO

DATE	NO	DESCRIPTION
10-31-07		RELEASE FOR PERMIT AND CONSTRUCTION

10-31-07
DATE